

Westfield, IN 46074

Transport and Driver Must Have Unencumbered Access to Site and Tank For Delivery

Customer to provide approved piping that is suitable for liquid nitrogen service from cryosauna units to connection point on liquid nitrogen tank.

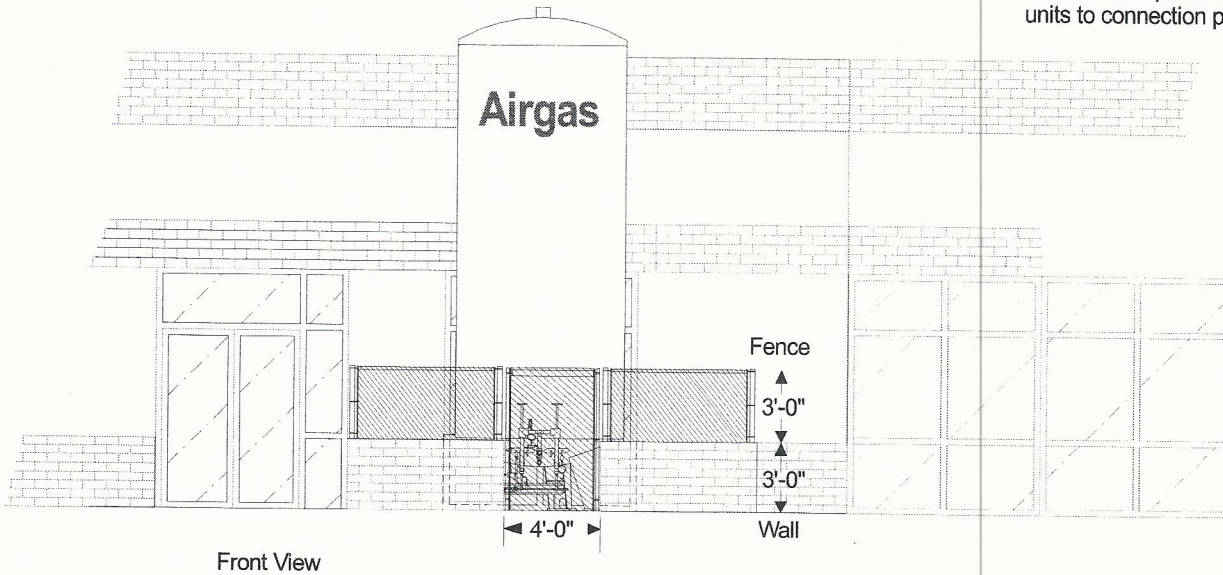


Diagram illustrating the construction of a tank pad. The diagram shows a cross-section of the tank pad and the concrete grade. The tank pad is made of salt impregnated polyurethane sealant Sikaflex 1a or other approved material. The concrete grade is 1/2 inch thick. The tank pad is 1/2 inch thick. The diagram also shows a cross-section of the tank pad and the concrete grade.

Depth must be below local frost line